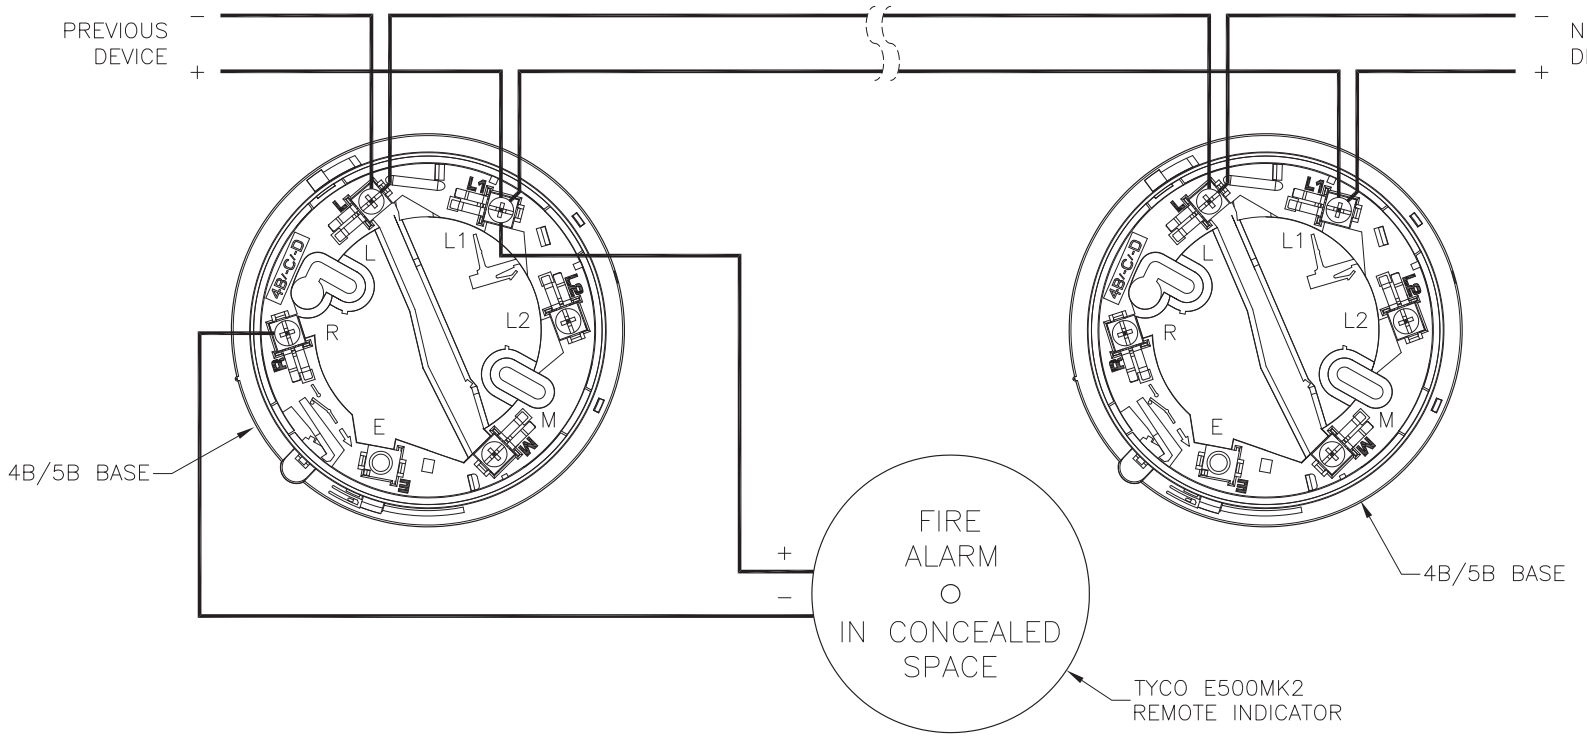


CONFIDENTIAL: THIS DOCUMENT MUST NOT BE COPIED NOR THE CONTENTS PASSED ON TO ANY THIRD PARTY WITHOUT THE CONSENT OF THE COMPANY.

UNLESS OTHERWISE STATED: ALL DIMENSIONS IN MILLIMETRES. DO NOT SCALE. TOLERANCES ARE TO BE: 1 DECIMAL PLACE ±0.5, 2 DECIMAL PLACES ±0.3, 3 DECIMAL PLACES ±0.1

3rd ANGLE PROJECTION


ISS/REV	AMENDMENTS	ECO	DRN	CHKD	AUTH	APVD	DATE
A	ORIGINAL	4809	KJS	LSC	RC	DK	12-11-15

tyco
Fire Protection Products
TYCO FIRE PROTECTION PRODUCTS
17 MARY MULLER DRIVE
P.O. BOX 19545
CHRISTCHURCH, PH: +64 3 3895096
NEW ZEALAND. FAX:+64 3 3895938

4100ESi
4B / 5B MX BASE
WIRING DIAGRAM

DRAWING No: 1976-181 SHEET 104 of 1

A3 | ISS/REV A | PART No:

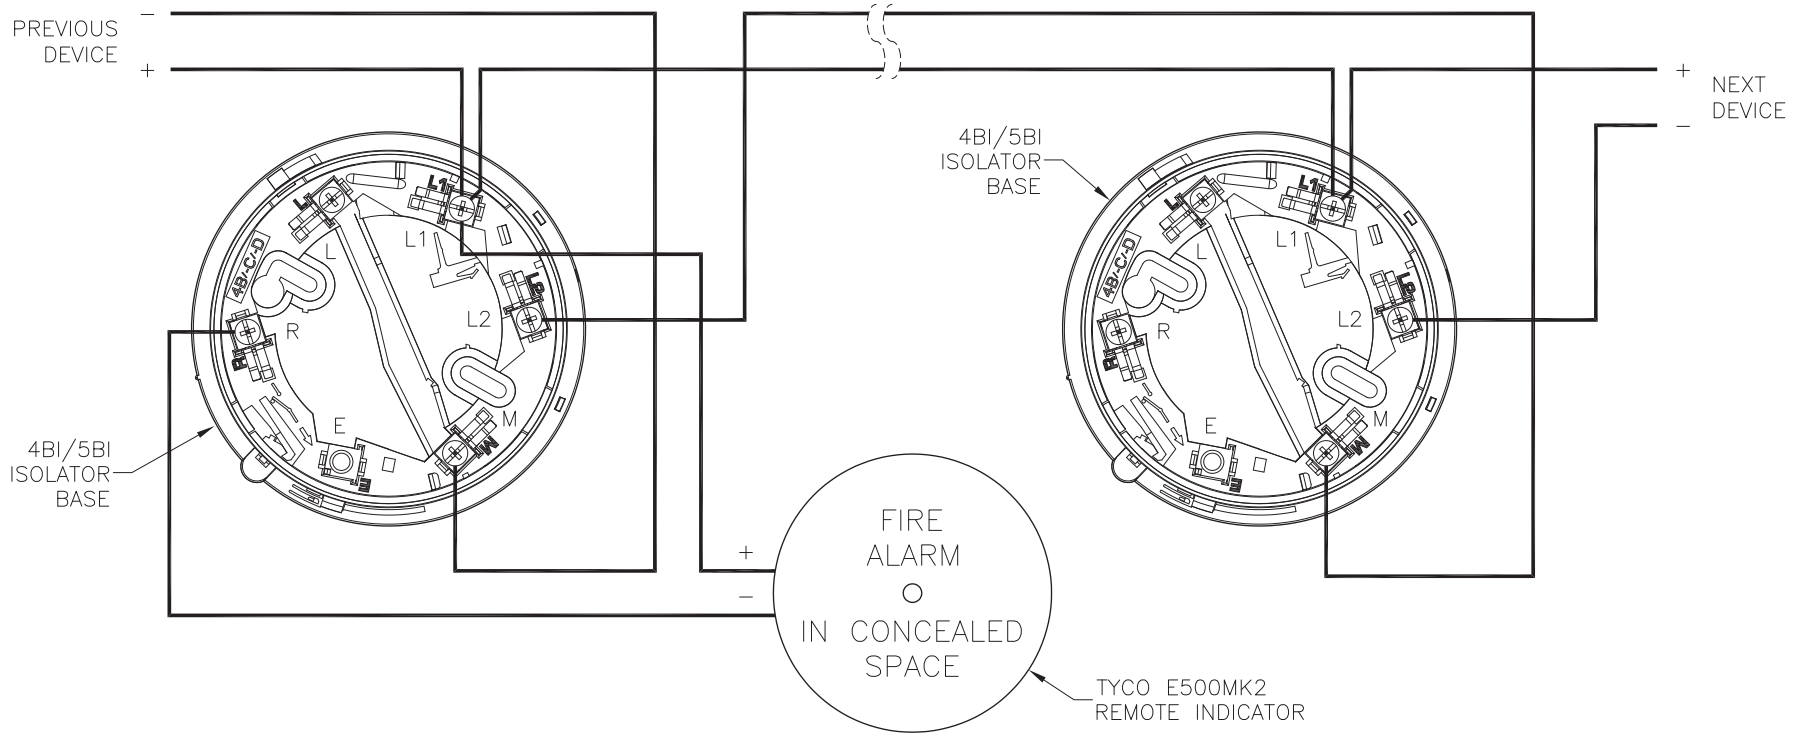

NOTES:
1. PROVIDES MX LOOP SHORT CIRCUIT ISOLATION.
2. MAX IB UNITS BETWEEN ISOLATORS = 100 IB UNITS.
3. FIT ISOLATORS BETWEEN ZONES AND BETWEEN DEVICES OF DIFFERENT FUNCTIONS, E.G., OUTPUTS FOR SECURITY AND PLANT.

CONFIDENTIAL: THIS DOCUMENT MUST NOT BE COPIED NOR THE CONTENTS PASSED ON TO ANY THIRD PARTY WITHOUT THE CONSENT OF THE COMPANY.

UNLESS OTHERWISE STATED: ALL DIMENSIONS IN MILLIMETRES. DO NOT SCALE. TOLERANCES ARE TO BE: 1 DECIMAL PLACE ±0.5, 2 DECIMAL PLACES ±0.3, 3 DECIMAL PLACES ±0.1

3rd ANGLE PROJECTION

ISS/REV	AMENDMENTS	ECO	DRN	CHKD	AUTH	APVD	DATE
A	ORIGINAL FROM 1982–71–103.	4809	KJS	LSC	RC	DK	12–11–15

tyco
Fire Protection Products
TYCO FIRE PROTECTION PRODUCTS
17 MARY MULLER DRIVE
P.O. BOX 19545
CHRISTCHURCH, PH: +64 3 3895096
NEW ZEALAND. FAX:+64 3 3895938

4100ESi
4BI / 5BI MX ISOLATOR BASE WIRING DIAGRAM

DRAWING No: 1976-181 SHEET 105 of N

A3 | ISS/REV A | PART No: