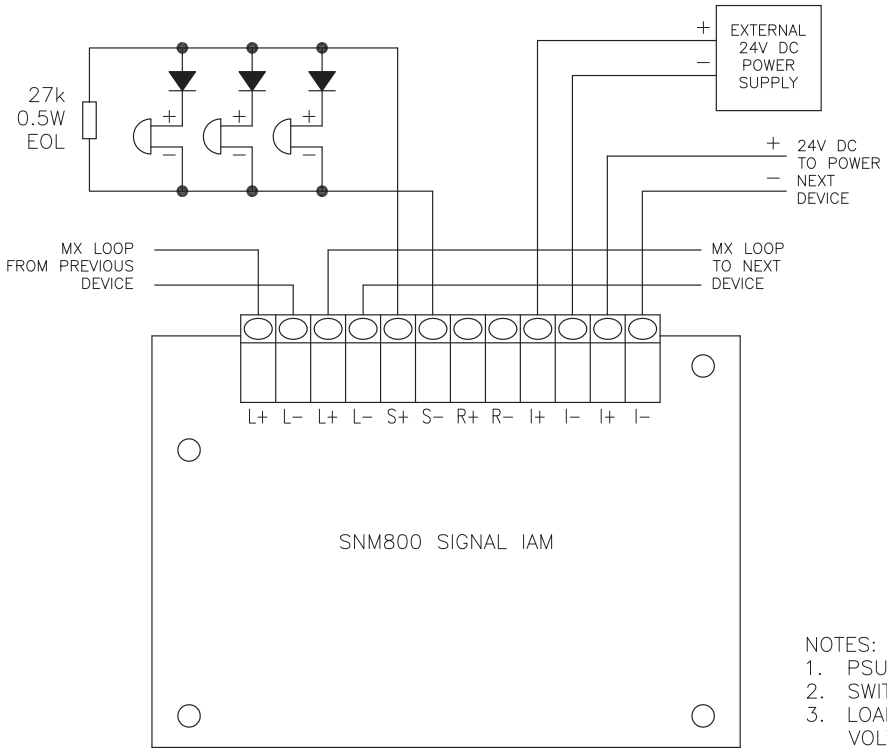


NOTES:
1. PSU: 20–30V DC.
2. SWITCHED OUTPUT: PSU VOLTAGE; 2A MAX. ELD: 27k.
3. LOAD DEVICES MUST HAVE SERIES DIODE AND BE VOLTAGE FREE.
4. INDUCTIVE LOADS MUST HAVE BACK–EMF DIODE OR SUPPRESSION.
5. DO NOT USE R+, R– TERMINAL.

CONFIDENTIAL: THIS DOCUMENT MUST NOT BE COPIED NOR THE CONTENTS PASSED ON TO ANY THIRD PARTY WITHOUT THE CONSENT OF THE COMPANY.

UNLESS OTHERWISE STATED: ALL DIMENSIONS IN MILLIMETRES. DO NOT SCALE. TOLERANCES ARE TO BE: 1 DECIMAL PLACE ±0.5, 2 DECIMAL PLACES ±0.3, 3 DECIMAL PLACES ±0.1

3rd ANGLE PROJECTION

ISS/REV	AMENDMENTS	ECO	DRN	CHKD	AUTH	APVD	DATE
A	ORIGINAL FROM 1982–71–111.	4809	KJS	LSC	RC	DK	12–11–15
B	PART NUMBERS CHANGED TO USE MX PART NUMBERS.	4936	KJS	MH	RC	DP	11–7–16

tyco
Fire Protection Products
TYCO FIRE PROTECTION PRODUCTS
17 MARY MULLER DRIVE
P.O. BOX 19545
CHRISTCHURCH, PH: +64 3 3895096
NEW ZEALAND. FAX:+64 3 3895938

4100ESi
SNM800 SIGNAL IAM
WIRING DIAGRAM

DRAWING No: 1976-181 SHEET 422 of N

A3 | ISS/REV B | PART No: